


# LOG TYPE INLET PROTECTION

NOT-TO SCALE

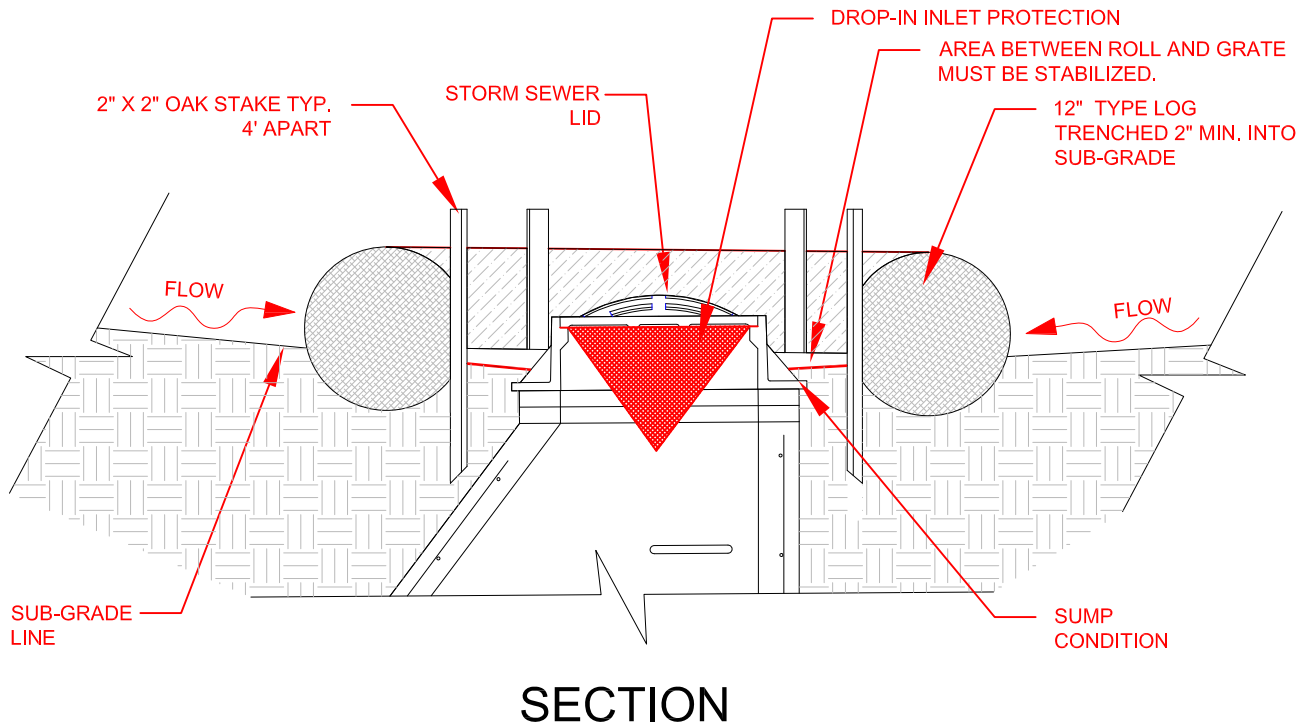

## NOTES:

1. 2 x 2 nominal hardwood stakes, 4 foot minimum length, driven into ground approximately 18 inches, stakes driven a minimum width of 12 inches away from the drop inlet.
2. Area inside the log, from edge of fabric to structure, must be stabilized with Erosion Control Blanket, Turf Reinforcement Mat, Geotextile 592 Table 2 Class 2 or CA-7 stone
3. Stakes must be a maximum of 4 feet apart.
4. A maintenance schedule must maintain a sediment accumulation of less than 50% of the height of the log.

## REFERENCE

Project \_\_\_\_\_  
Designed \_\_\_\_\_ Date \_\_\_\_\_  
Checked \_\_\_\_\_ Date \_\_\_\_\_  
Approved \_\_\_\_\_ Date \_\_\_\_\_

## STANDARD DWG. NO.

IUM-531

SHEET 1 OF 1

DATE 04-6-15